

Vent-Axia[®]

ELECTRONIC TIMER FOR HEATING AND VENTILATION CONTROL

STOCK REF 42 64 15 ELECTRONIC RUN-BACK TIMER

WHEN USED WITH FLUORESCENT LIGHTING, PLEASE ENSURE A POWER FACTOR CORRECTION CAPACITOR OF 2 MICROFARADS (MINIMUM) IS FITTED.

IMPORTANT NOTICE

! ALL WIRING SHOULD BE CARRIED OUT BY A QUALIFIED ELECTRICIAN IN ACCORDANCE WITH THE CURRENT IEE WIRING REGULATIONS.


USAGE

This electronic timer is designed to control immersion heaters, panel heaters, fans and lighting. The timing-out period is adjustable between 15 minutes and 2 hours in 15 minute increments. The LED display shows how much time is left to run during operation.

The controller is compatible with a single gang, 25mm deep British Standard accessory plate. Please ensure that the top and bottom lugs are removed, if fitted, from metal wall boxes prior to fitting. Ensure that there is adequate space for wiring.


WIRING

Wire the unit following the diagram below.

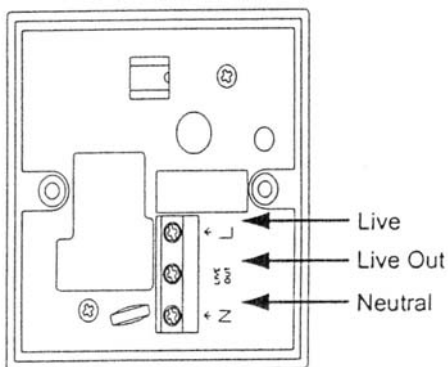

Rating at 240V ac:-

Heating 20A/4800W
Incandescent 7A
Fluorescent 6A
Time Delay 15 min-2Hrs

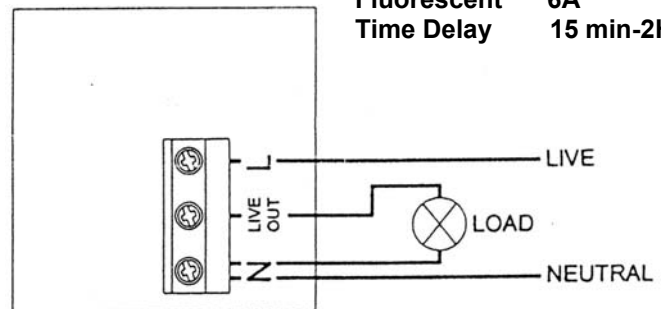

OPERATION

1. To select the desired time delay, press and release the **TIME** button on the front panel until the required timing period is displayed (i.e. 1 press = 15 minutes, 2 presses = 30 minutes, etc.) – the LED display will flash next to the current time setting.
2. Press the **ON/OFF** button on the front panel to switch on the load for the desired time period – the LED display will come on next to the current time setting, and will show how much time is left to run during operation.
3. To cancel the timing sequence, press the **ON/OFF** button again.
4. To change the timing period whilst the unit is on, press the **TIME** button.
5. When the timing period is over, the load will switch off and the LED display will switch off.
6. Pressing the **ON/OFF** button again will repeat the previously set timing period.



VENT-AXIA CONTACT NUMBERS

UK NATIONAL SALES CENTRE

Domestic & Commercial

Tele: 01293 530202

Fax: 01293 565169

Industrial

Tele: 01293 441570

Fax: 01293 534898

REPUBLIC OF IRELAND

Vent-Axia Ventilation Ltd.

921 Western Road Industrial Estate

Naas Road, Dublin 12.

Tele: (01) 450 4133

Fax: (01) 450 4570

UK NATIONAL TECHNICAL SUPPORT

Domestic & Commercial

Tele: 01293 526062

Fax: 01293 551188

Industrial

Tele: 01293 455196

Fax: 01293 455197

Internet site at: www.vent-axia.com

Email: info@vent-axia.com

The Vent-Axia Guarantee

Applicable only to products installed and used in the United Kingdom. For details of the Guarantee outside of the United Kingdom contact your local supplier.

Vent-Axia guarantees this product for one year from the date of purchase against faulty material or workmanship. In the event of any part being found to be defective, the product will be repaired, or at the Company's discretion the product will be replaced without charge, provided that the product:

- 1). Has been installed and used in accordance with the instruction given with each unit.
- 2). The electricity supply complies with the rating label.
- 3). Has not been misused, neglected or damaged.
- 4). Has not been modified or repaired by any person not authorized to do so by Vent-Axia.

IF CLAIMING UNDER THE TERMS OF THE GUARANTEE

Please return the complete product, carriage paid to your original supplier by post or in person. Please ensure that it is adequately packed and accompanied by a letter clearly marked 'Guarantee Claim' stating the nature of the fault and providing proof of the date and source of purchase

As part of the policy of continuous product improvement
Vent-Axia reserve the right to alter specifications without notice

Vent-Axia

Head Office: Fleming Way, Crawley, West Sussex RH10 9YX

Tel: 01293 526062 Fax: 01293 551188

Internet site at: www.vent-axia.com