

# Vent-Axia®



## VARSU Remote Switch Unit

### Installation & Wiring Instructions

Stock Ref:- 436494


#### Important

All Electrical connections should be made by a properly qualified electrician. The sitting and installation **MUST** comply with the current I.E.E Regulations (BS7671 UK) or the appropriate standards in your country. The Remote Switch Unit VARSU is for use with air curtains and other heaters where remote switching is required. The unit comprises of one 20A double pole and two 20A single pole switches in a surface mounting box, 166mm x 86mm x 40mm deep. The unit is supplied wired for use.

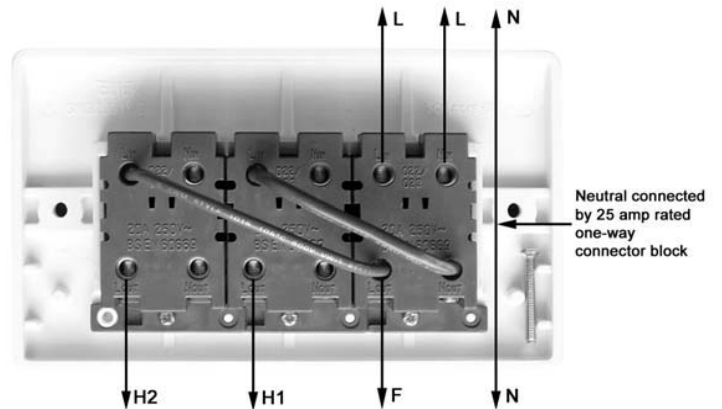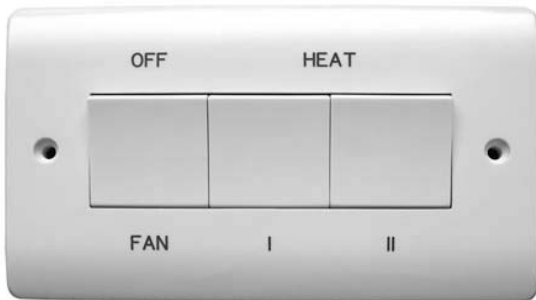

#### Wiring

All wiring connected to the heater switches and 3-way terminal block should be removed and connections between the 4-way terminal block and the remote switch made as shown in the diagram below. The neutral is not switched. A suitable double pole isolation switch should be incorporated in the circuit. For safety reasons, a sound earth connection must always be made to the unit before use.

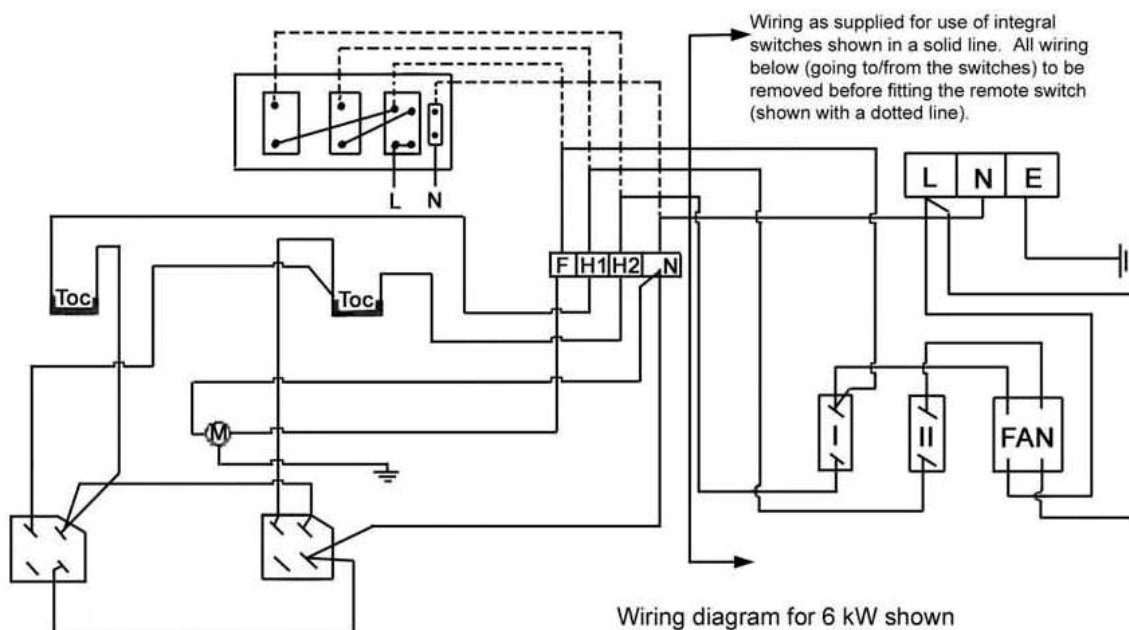

All regulations and requirements **MUST** be strictly followed to prevent hazards to life and property both during and after installation, and during any subsequent servicing and maintenance.

**VENT-AXIA CONTACT NUMBERS  
UK NATIONAL SALES CENTRE**

**Domestic & Commercial**

Tele: 01293 530202

Fax: 01293 565169

**Industrial**

Tele: 01293 441570

Fax: 01293 534898

**REPUBLIC OF IRELAND**

Vent-Axia Ventilation Ltd.

Tele: (01) 450 4133 Fax: (01) 450 4570

**UK NATIONAL TECHNICAL SUPPORT**

**Domestic & Commercial**

Tele: 01293 526062

Fax: 01293 551188

Internet site at: [www.vent-axia.com](http://www.vent-axia.com)

**Industrial**

Tele: 01293 455196

Fax: 01293 455197

Email: [info@vent-axia.com](mailto:info@vent-axia.com)

**The Vent-Axia Guarantee**

Applicable only to products installed and used in the United Kingdom. For details of the Guarantee outside of the United Kingdom contact your local supplier.

Vent-Axia guarantees this product for two years from the date of purchase against faulty material or workmanship. In the event of any part being found to be defective, the product will be repaired, or at the Company's discretion the product will be replaced without charge, provided that the product:

- 1). Has been installed and used in accordance with the instruction given with each unit.
- 2). The electricity supply complies with the rating label.
- 3). Has not been misused, neglected or damaged.
- 4). Has not been modified or repaired by any person not authorized to do so by Vent-Axia.

**IF CLAIMING UNDER THE TERMS OF THE GUARANTEE**

Please return the complete product, carriage paid to your original supplier by post or in person. Please ensure that it is adequately packed and accompanied by a letter clearly marked 'Guarantee Claim' stating the nature of the fault and providing proof of the date and source of purchase.

As part of the policy of continuous product improvement  
Vent-Axia reserve the right to alter specifications without notice

***Vent-Axia***®